

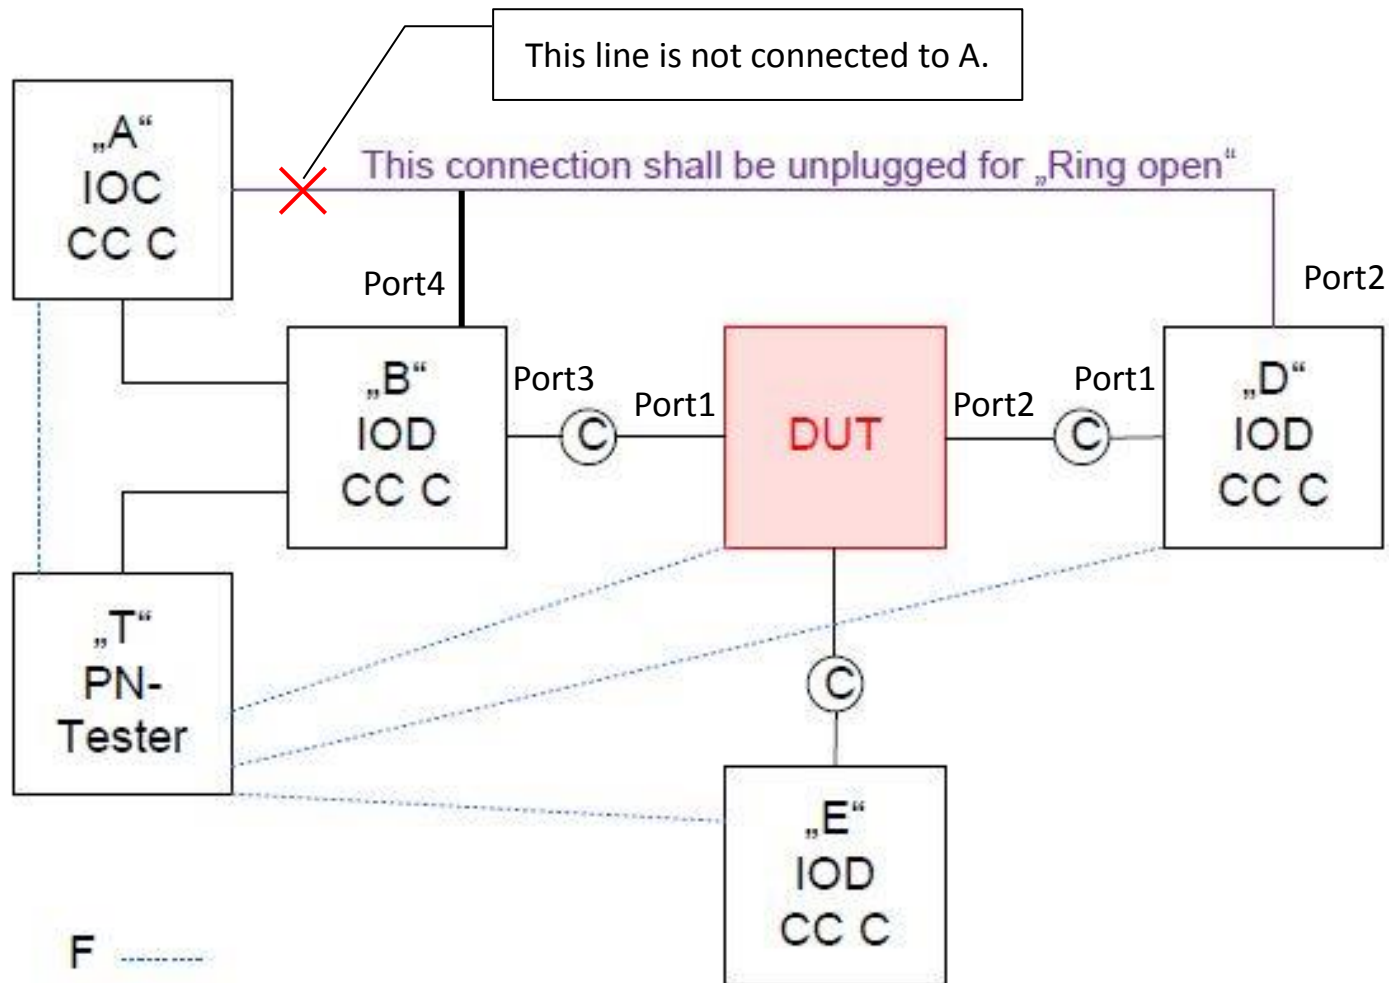


Figure 7-15 MRP test setup

A: Siemens PLC S7-1200

B: Siemens Switch XF204

DUT: Customer board (AM3357)

D: Customer board